


UKPN STATS SHOWS HV UNDERGROUND CABLES IN THIS SCHEME. REFER TO DIG PACK PRIOR TO INSTALL.

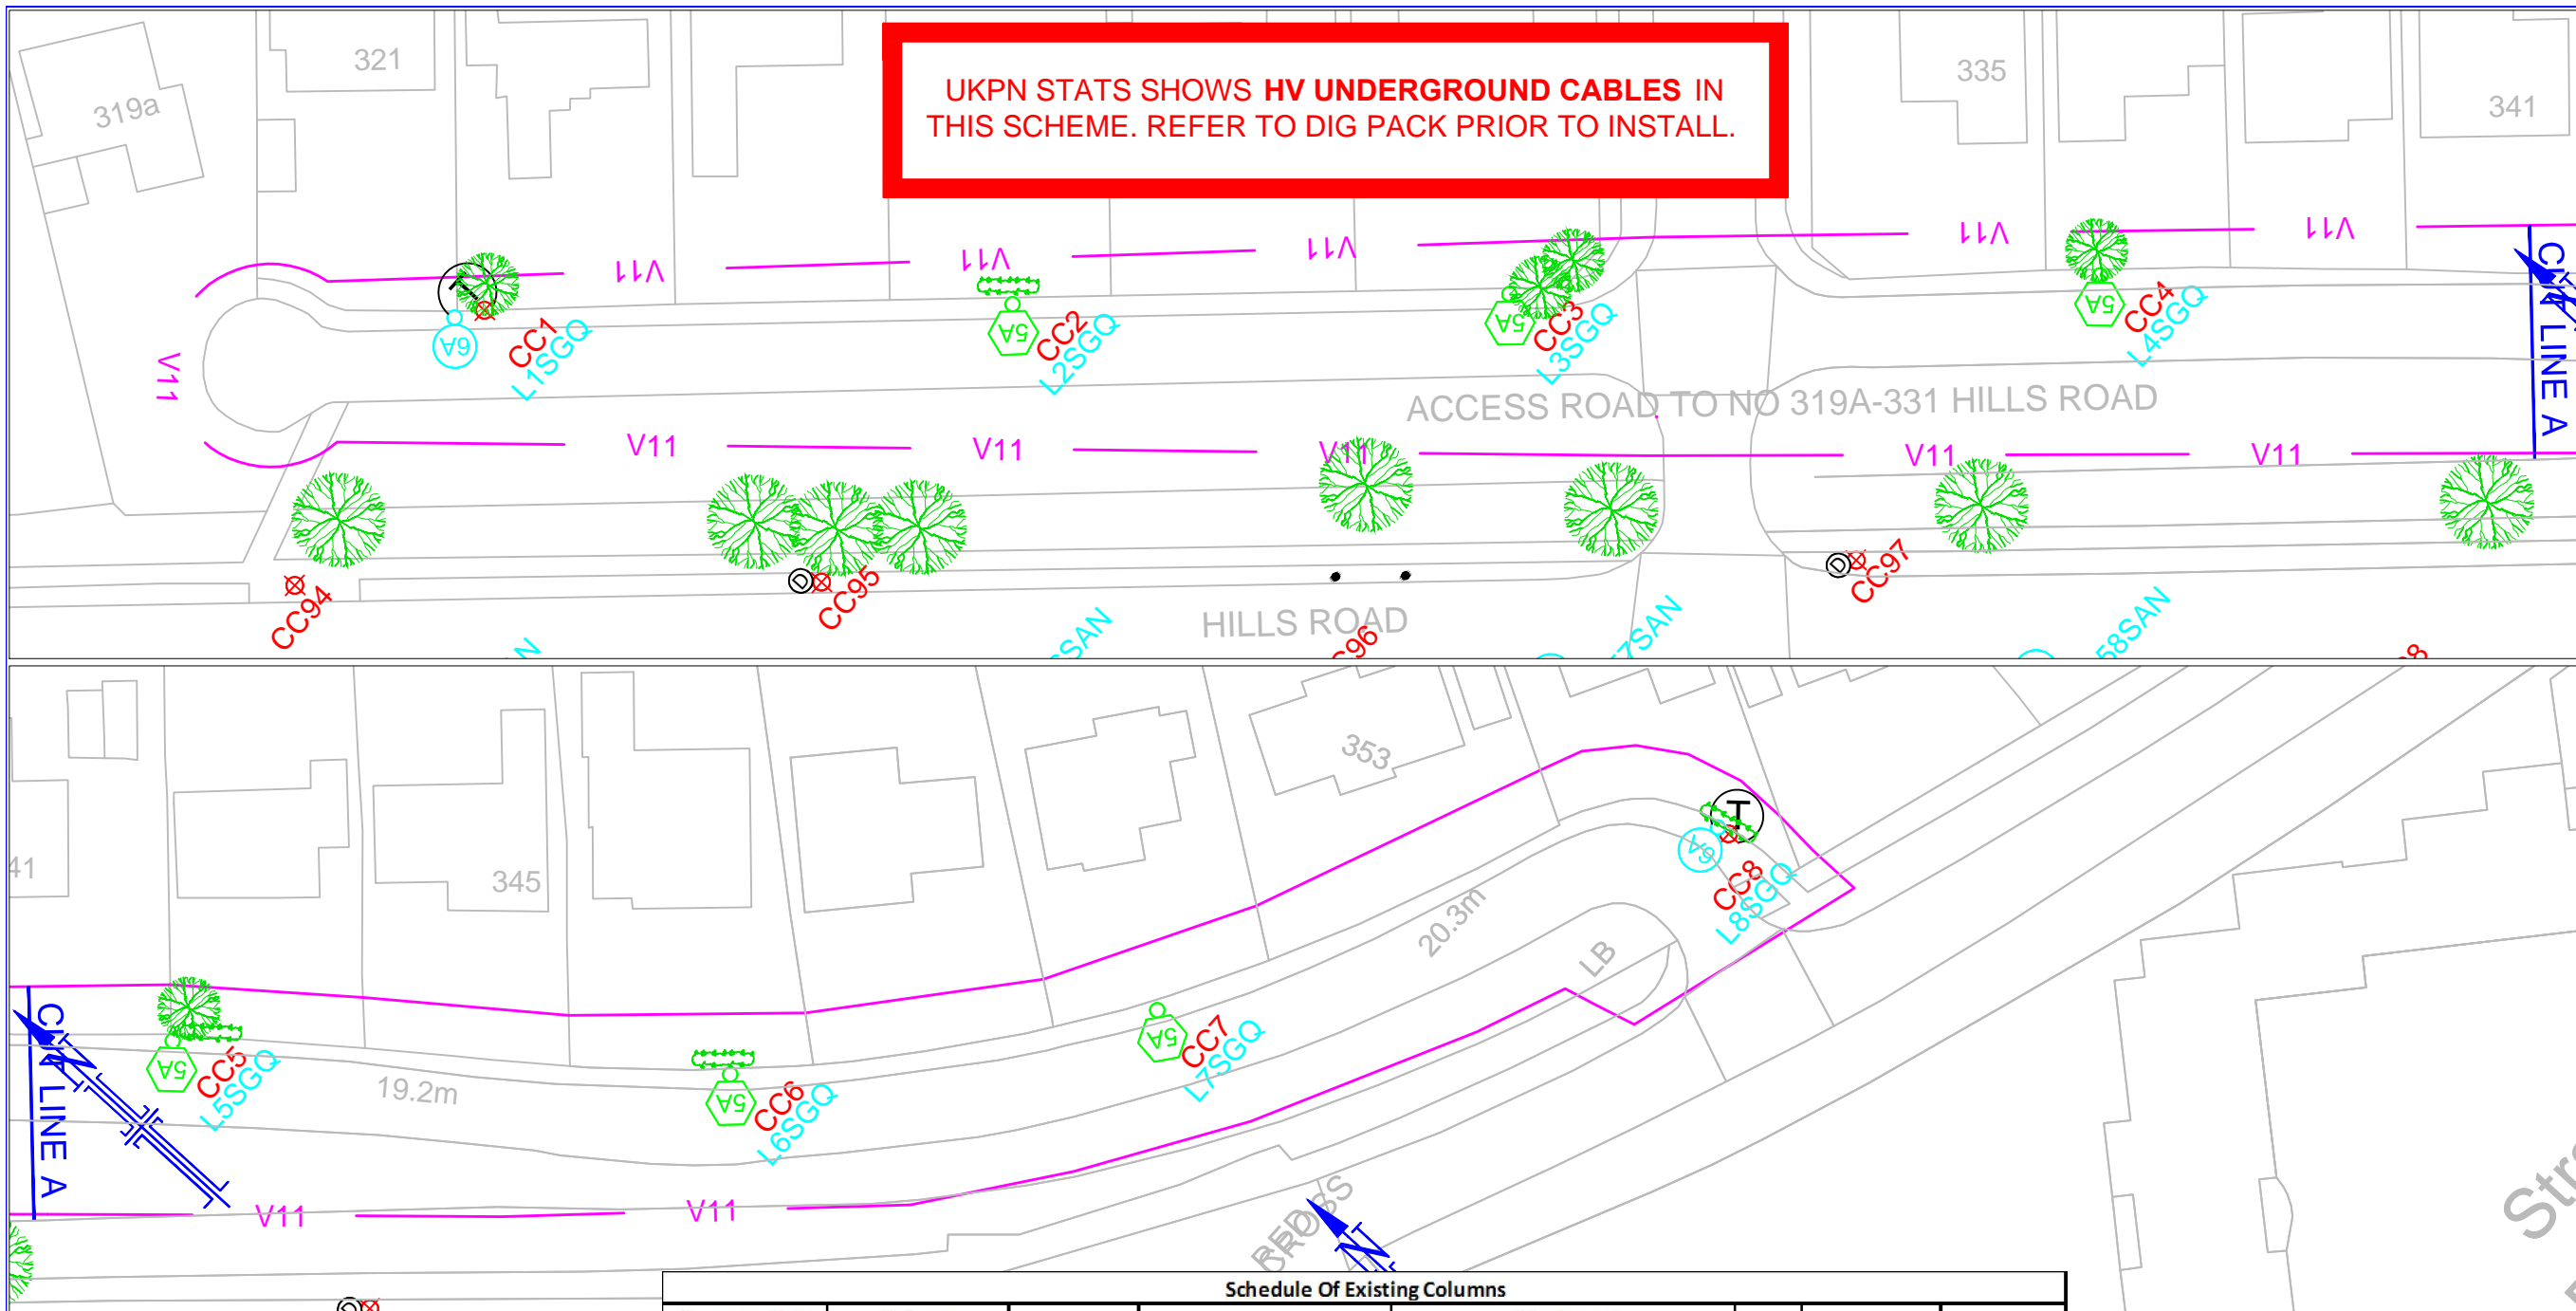

- KEY**
- (6A) **Lantern:** Philips Residium FGS224/Libra-PT
Tilt: 5°
Column: 6m Stepped Tubular Steel
Lamp: 36W PL-L
Control: Telensa
 - (5A) **Lantern:** Philips Residium FGS224/Libra
Tilt: 5° - **PT New Spigot**
Column: 5m Octagonal Steel
Lamp: 36W PL-L
Control: Telensa
 - ⊗ Existing Non DTC Lighting Column To Be Removed For Recycling
 - ⊕ Transfer of DNO Supply
 - (T) Tree
 - (H) Hedge

- Design Notes**
1. 1-4-1 (Residential) Lighting Design
 2. CC8 (L8SGQ); DTC status removed - column found damaged during survey

All lighting column positions marked on site are indicative only

Notes
DIMMING REGIME
• RESIDENTIAL DIM TO 60% BETWEEN 22.00 & 06.00

WARNING - THERE ARE BURIED SERVICES WITHIN THIS SCHEME. REFER TO DIG PACK PRIOR TO REMOVAL / INSTALL AND ENSURE DIG PACK CONTAINS ALL THE INFORMATION
COPYRIGHT RESERVED, BALFOUR BEATTY LIVING PLACES IS THE OWNER OF THE COPYRIGHT SUBSISTING IN THESE DRAWINGS, PLANS, DESIGNS AND SPECIFICATIONS. THEY MUST NOT BE USED, REPRODUCED OR COPIED, IN WHOLE OR IN PART, NOR MAY THE INFORMATION, IDEAS AND CONCEPTS THEREIN CONTAINED (WHICH ARE CONFIDENTIAL TO BALFOUR BEATTY LIVING PLACES) BE DISCLOSED TO ANY PERSON WITHOUT THE PRIOR SPECIFIC WRITTEN CONSENT OF BALFOUR BEATTY LIVING PLACES.



Designer: PT Date of issue: 23/10/14

Checked: DM Authorised: NB Sheet Size: A3 Scale: 1:500 @ A3

Issue: PRELIMINARY Revision: ORIG.

Drawing no.: 7200-1425-V11

Scheme Name and Ward:
Cambridge 1425,
Cambridge City

Streets on drawing:
Access Road to
no. 319a-331 Hills Rd,
Milestone 7
Sheet 1 of 1

Schedule Of Existing Columns									
Access to 331a Hills Rd	Column		Supply Point	Service Alteration Type	Attachment		Notes	Location	Lamp/Types
	Number	Set back			Type	Alteration Type			
Lighting Column	CC1	BOP	DNO	Transfer to L1SGQ				o/s no. 323	35W SOX
	CC2	BOP	DNO	DTC Lantern Change Only	Parking Plate	none		o/s no. 327	
	CC3	BOP	DNO	DTC Lantern Change Only	Parking Plate	none		o/s no. 331	
	CC4	BOP	DNO	DTC Lantern Change Only				o/s no. 337	
	CC5	BOP	DNO	DTC Lantern Change Only	Parking Plate	none		o/s no. 343	
	CC6	BOP	DNO	DTC Lantern Change Only				o/s no. 347	
	CC7	BOP	DNO	DTC Lantern Change Only	Parking Plate	none		o/s no. 349	
	CC8	BOP	DNO	Transfer to L8SGQ	Parking Plate	Transfer to L8SGQ		o/s no. 355	

Schedule Of Proposed Columns									
Access to 331a Hills	Column		Supply Point	Service Alteration Type	Attachment		Notes	Location	Lamp/Types
	Number	Set back			Type	Alteration Type			
Lighting Column	L1SGQ	BOP	DNO	Transfer from CC1				o/s no. 323	36W PL-L
	L2SGQ	BOP	DNO	DTC Lantern Change Only	Parking Plate	Retain		o/s no. 327	
	L3SGQ	BOP	DNO	DTC Lantern Change Only	Parking Plate	Retain		o/s no. 331	
	L4SGQ	BOP	DNO	DTC Lantern Change Only				o/s no. 337	
	L5SGQ	BOP	DNO	DTC Lantern Change Only	Parking Plate	Retain		o/s no. 343	
	L6SGQ	BOP	DNO	DTC Lantern Change Only				o/s no. 347	
	L7SGQ	BOP	DNO	DTC Lantern Change Only	Parking Plate	Parking Plate		o/s no. 349	
	L8SGQ	BOP	DNO	Transfer from CC8	Parking Plate	Transfer from CC8		o/s no. 355	